

A Resonant Switched-Capacitor *LLC* DCX in Data Center Applications

Jiawei Liang, Haoyu Wang
 School of Information Science and Technology
 ShanghaiTech University, Shanghai, China
 wanghy@shanghaitech.edu.cn

Abstract—In this paper, a novel resonant switched-capacitor *LLC* topology is proposed to serve as the dc transformer (DCX) in data center applications. The proposed DCX is formed by a 2:1 resonant switched-capacitor cell and an *LLC* converter. To achieve a $4n:1$ voltage step-down ratio, only an $n:1$ turns ratio transformer is required. It presents good soft-charging and soft-switching performances to effectively mitigate charge distribution loss and switching loss. Furthermore, the voltage stresses of primary switches are only half of the input voltage, and the current stresses are also lower than that of conventional *LLC* converter. The operational principle of steady-state circuit and theoretical analysis are provided to highlight its advantages. To verify the proposed concept, a 300W-rated hardware prototype that converts 48 V to 12 V is designed and tested with 1MHz switching frequency.

Keywords—dc transformer, *LLC*, soft switching, switched-capacitor converter, voltage regulator modules

I. INTRODUCTION

The rapid evolution of various networking applications, such as cloud computing, Internet of Things (IoT), artificial intelligence, and mobile communication, has resulted in a significant surge in power consumption demands for data centers [1]. As a result of the growing electricity demand, there is a shift from the conventional 12V bus architecture to a more advanced 48V bus architecture in data centers to achieve higher efficiency and power density [2], [3]. However, a new challenge emerging from 48V bus is the optimal design of load-side voltage regulator modules (VRMs).

For the 48V VRM, two-stage intermediate bus architecture (IBA) [4] is a prevalent approach due to its superior deployment flexibility and transient performance [5]. This structure utilizes an intermediate bus converter (IBC) in the front end to convert the bus voltage (40V-60V) to an intermediate voltage (5V-12V), and a point-of-load (PoL) converter [6] is employed in the back end to provide final step down and regulation function for terminal loads. For the front-end IBC, voltage regulation is not mandatory. Thus, the IBC is generally operated as a dc transformer (DCX) to improve performance in efficiency and power density.

Various topologies are suitable for IBCs including switched-capacitor-based solutions and transformer-based solutions [7]. For switched-capacitor-based solutions, switched capacitor converters (SCCs) [8] offer significant advantages in achieving high efficiency and power density due to less magnetics utilization. Moreover, resonant SCC [9]–[11] can further improve the efficiency by incorporating small inductors into the SCC to eliminate the charge redistribution losses. Alternatively, some transformer-based solutions are also potential candidates for DCX, especially in handling high voltage conversion ratios. Among them, *LLC* DCX [12]–[14] has been regarded as a selection for high-efficiency operation due to its excellent soft-switching characteristics.

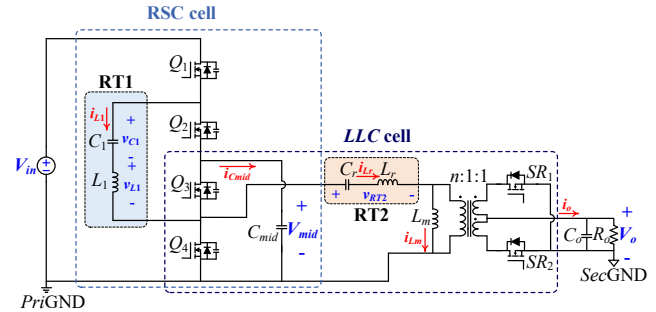


Fig. 1. The schematic of proposed hybrid RSC-*LLC* DCX.

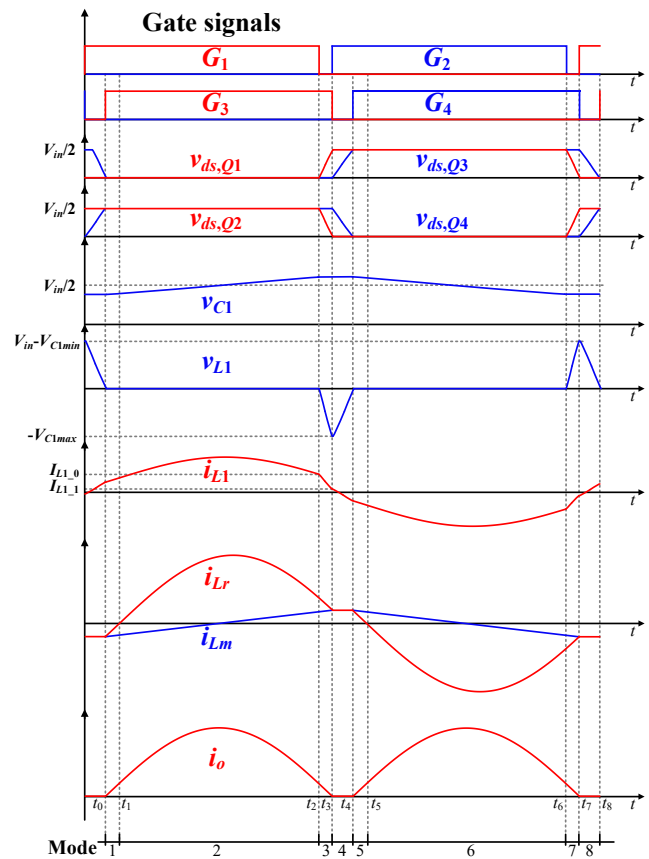


Fig. 2. Idealized waveforms at steady-state.

In this paper, a hybrid DCX topology based on resonant switched capacitor converter and *LLC* converter is proposed to further improve the DCX's performance. The proposed DCX combines resonant switched-capacitor (RSC) cell with *LLC* converter by sharing a half-bridge structure. It can achieve a $4n:1$ voltage conversion ratio with an $n:1$ turns ratio transformer. Furthermore, the voltage stress on primary switches is only half of that in conventional *LLC* design, while maintaining lower current stresses at a lower turns ratio. The soft-charging and soft switching features are also achieved in

This work was supported in part by the National Natural Science Foundation of China under Grant 52077140.

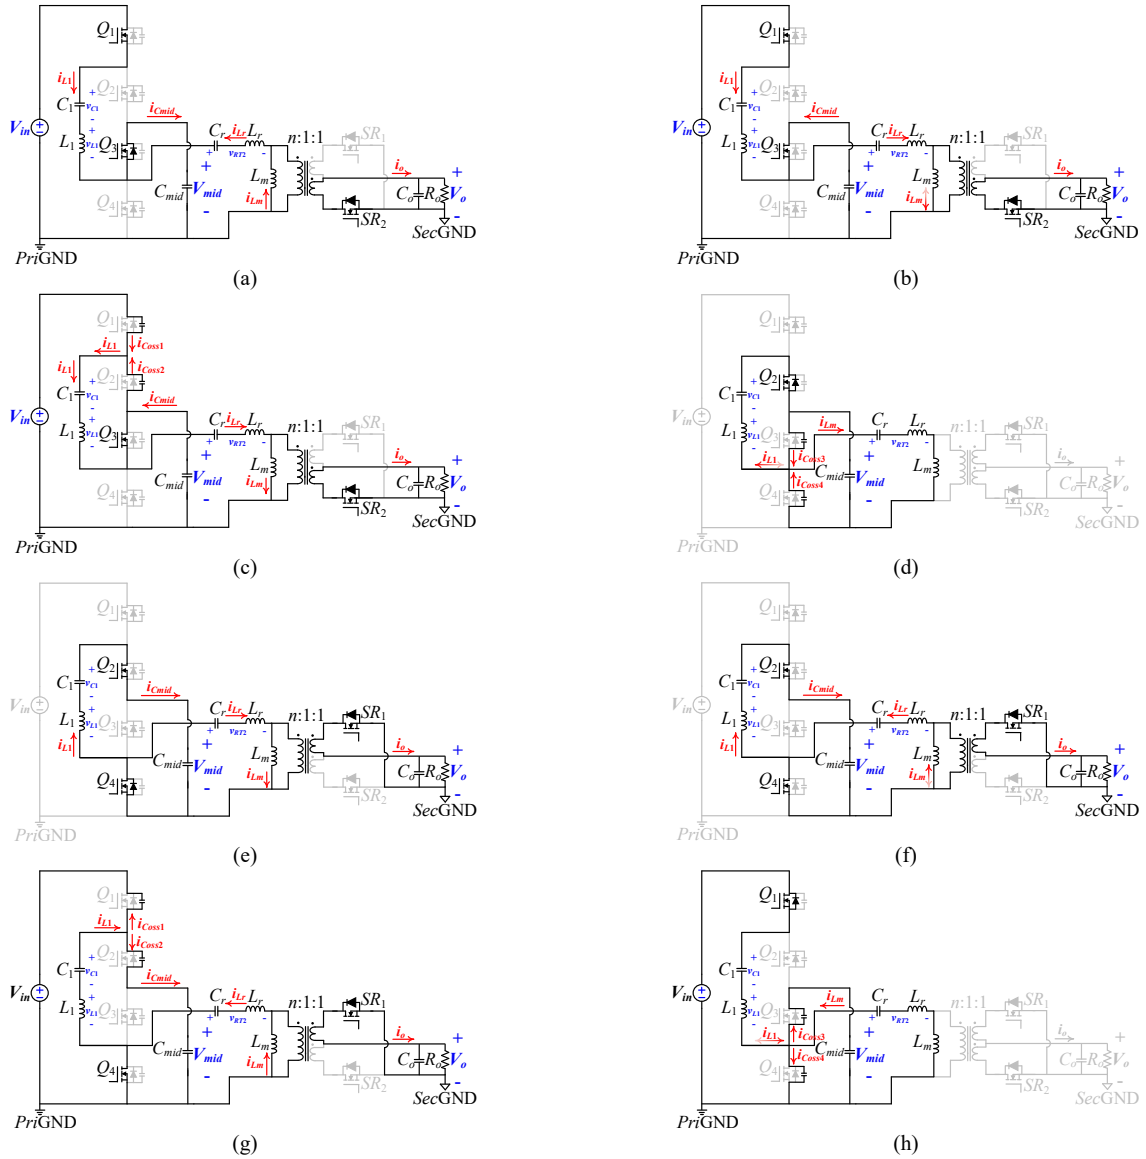


Fig. 3. Equivalent circuits: (a) Mode 1. (b) Mode 2. (c) Mode 3. (d) Mode 4. (e) Mode 5. (f) Mode 6. (g) Mode 7. (h) Mode 8.

the proposed DCX. Basic converter operation is analyzed to depict the concept. A 48V-to-12V converter prototype is built and tested to verify the theoretical analysis.

II. OPERATIONAL PRINCIPLE AND ANALYSIS

A. Proposed Topology and Operating Principle

Fig. 1 shows the schematic of the proposed resonant switched-capacitor LLC DCX with $4n:1$ conversion ratio. It combines a $2:1$ resonant switched-capacitor cell and a half-bridge LLC cell by merging a half-bridge structure. There are four switches with two pairs of complementary gate signals, among which the gate signals of Q_1, Q_2 are one pair, and the signals of Q_3, Q_4 are the other pair. Both of them have a duty cycle of 50% with certain dead time. The resonant frequency of the resonant tank 2 (RT2) is designed to match the switching frequency so that the LLC cell can achieve optimal efficiency. Depending on a small phase-shift between two pairs of gate signals, all primary switches have the potential to achieve ZVS. To ensure full ZVS, the resonant frequency of the resonant tank 1 (RT1) should be slightly lower than switching frequency to store sufficient energy in L_1 during switching transition.

The circuit operation can be divided into eight modes, and the key waveforms are illustrated in Fig. 2. G_{1-4} are the gate signals of Q_{1-4} , $v_{ds,Q_{1-4}}$ represent the drain-to-source voltages of Q_{1-4} , v_{C1} and v_{L1} are the voltage of C_1 and L_1 , i_{L1} represents the resonant current of L_1 , i_{Lr} and i_{Lm} are the resonant current and magnetizing current in RT2, and the output current is denoted as i_o . The corresponding equivalent circuits are shown in Fig. 3. The positive current direction and voltage polarity are denoted in Fig. 1. To simplify the analysis, the output parasitic capacitance C_{oss} of the primary switches is assumed to be identical and linear. Due to the operational symmetry, only half switching cycle with four modes are detailed.

Mode 1 (t_0-t_1): At $t=t_0$, the output capacitor of Q_3 and Q_4 have already been fully charged and discharged, resulting in the ZVS turn-on of Q_3 . The corresponding equivalent circuit is illustrated in Fig. 3(a). The output current i_o freewheels through SR_2 , and the voltage of L_m is clamped by $-V_o$. This interval ends when i_{Lr} reaches zero.

Mode 2 (t_1-t_2): At $t=t_1$, i_{Lr} becomes positive, and the equivalent circuit is shown in Fig. 3 (b). The input voltage source V_{in} charges RT1, RT2, and the output load, while the middle non-resonant capacitor C_{mid} also charges RT2 and the

output load. As a result, the current i_{Lr} is the sum of i_{L1} and i_{Cmid} . i_{Lm} increases linearly from negative to positive.

Mode 3 (t_2 - t_3): At $t=t_2$, Q_1 turns off, and the equivalent circuit is shown in Fig. 3(c). i_{L1} charges and discharges the C_{oss} of Q_1 and Q_2 until the C_{oss} of Q_2 is fully discharged and its body diode conducts, enabling ZVS turn-on of Q_2 .

Mode 4 (t_3 - t_4): In this interval, the equivalent circuit is shown in Fig. 3(d). Q_2 turns on with ZVS, and Q_3 is turned off. The resonant current i_{Lr} is clamped by i_{Lm} , and the difference between i_{Lm} and i_{L1} charges and discharges the C_{oss} of Q_3 and Q_4 until the C_{oss} of Q_4 is fully discharged and its body diode conducts. It enables ZVS turn-on of Q_4 .

B. ZVS Analysis

During one switching cycle, there are four deadbands, which correspond to Mode 3, Mode 4, Mode 7, and Mode 8. For Q_1 and Q_2 , ZVS is achieved by utilizing the energy stored in L_1 . However, the ZVS condition of Q_3 and Q_4 is dependent on the difference current between i_{Lm} and i_{L1} . Therefore, two situations should be analyzed to estimate the dead times for different switches.

1) The dead time of Q_1 and Q_2 can be denoted as t_{d1} , and the ZVS condition can be expressed by the inequality:

$$\frac{1}{2}L_1I_{L1,0}^2 \geq C_{oss}V_{ds}^2 \quad (1)$$

where $I_{L1,0}$ represents the current flowing through L_1 at the beginning of the dead time, and V_{ds} is the drain-to-source voltage of switch. It is important to note that all primary-side switches have identical C_{oss} and V_{ds} , and the V_{ds} value is equal to $V_{in}/2$.

To estimate the minimum dead time t_{d1} for Q_1 and Q_2 , Mode 3 is used as an example. In this case, v_{C1} is assumed to remain constant during the short dead time and is approximately equal to V_{mid} . Moreover, the energy stored in L_1 is assumed to be precisely enough to fully charge and discharge the C_{oss} of Q_1 and Q_2 . The state equations can be expressed as follows:

$$\begin{cases} v_{ds,Q2} = v_{C1} + v_{L1} \\ v_{L1} = L_1 \frac{di_{L1}}{dt} \\ i_{L1} = -2C_{oss} \frac{dv_{ds,Q2}}{dt} \end{cases} \quad (2)$$

with the initial state

$$\begin{cases} v_{C1} = V_{mid} \\ v_{ds,Q2}(t_2) = \frac{V_{in}}{2} \\ i_{L1}(t_2) = I_{L1,0} \end{cases} \quad (3)$$

Thus, the expressions of $v_{ds,Q2}$ and i_{L1} can be calculated as:

$$\begin{cases} v_{ds,Q2}(t) = \frac{V_{in}}{2} - I_{L1,0}Z_0 \sin[\omega_0(t-t_2)] \\ i_{L1}(t) = I_{L1,0} \cos[\omega_0(t-t_2)] \end{cases} \quad (4)$$

where

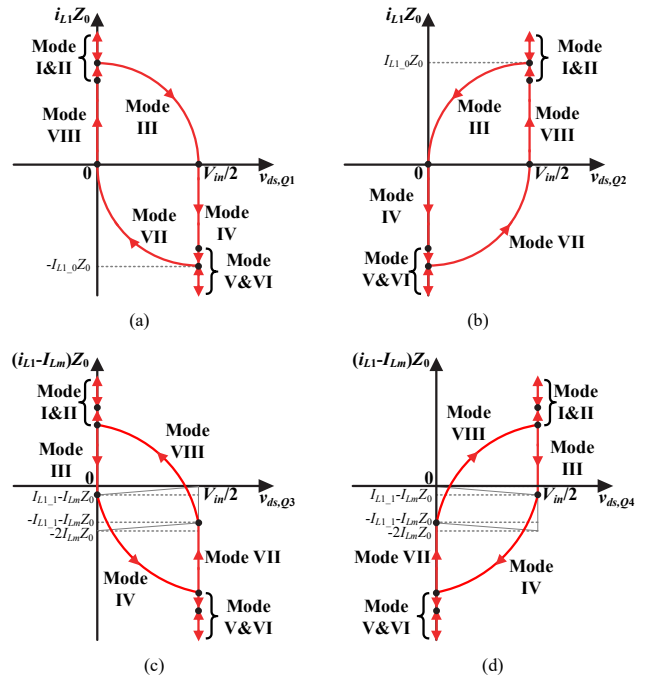


Fig. 4. Trajectories: (a) $i_{L1}Z_0$ - $v_{ds,Q1}$. (b) $i_{L1}Z_0$ - $v_{ds,Q2}$. (c) $(i_{L1}-I_{Lm})Z_0$ - $v_{ds,Q3}$. (d) $(i_{L1}-I_{Lm})Z_0$ - $v_{ds,Q4}$.

$$\begin{cases} \omega_0 = \frac{1}{\sqrt{2C_{oss}L_1}} \\ Z_0 = \sqrt{\frac{L_1}{2C_{oss}}} \end{cases} \quad (5)$$

Since $v_{ds,Q1}+v_{ds,Q2}=V_{in}-V_{mid}=V_{in}/2$, two trajectories during Mode 3 can be derived:

$$\begin{cases} [v_{ds,Q1}(t)]^2 + [i_{L1}(t)Z_0]^2 = (I_{L1,0}Z_0)^2 \\ [v_{ds,Q2}(t) - \frac{V_{in}}{2}]^2 + [i_{L1}(t)Z_0]^2 = (I_{L1,0}Z_0)^2 \end{cases} \quad (6)$$

Fig. 4(a) and (b) illustrate the complete trajectories of $i_{L1}Z_0$ with respect to $v_{ds,Q1}$ and $v_{ds,Q2}$. The minimum dead time t_{d1} necessary to achieve ZVS must satisfy the following inequality:

$$t_{d1} \geq \frac{\pi/2}{\omega_0} \quad (7)$$

2) For Q_3 and Q_4 , the difference current between i_{Lm} and i_{L1} is responsible for charging and discharging the output capacitance, and the dead time can be denoted as t_{d2} . Mode 4 is used as an example to estimate the minimum t_{d2} . During this mode, I_{Lm} can be considered constant, and $I_{L1,1}$ represents the value of i_{L1} at $t=t_3$. Using the same derivation method, the expressions of $v_{ds,Q3}$ and i_{L1} can be calculated as:

$$\begin{cases} v_{ds,Q3}(t) = \frac{V_{in}}{2} \{1 - \cos[\omega_0(t-t_3)]\} - (I_{L1,1} - I_{Lm})Z_0 \sin[\omega_0(t-t_3)] \\ i_{L1}(t) = I_{Lm} + (I_{L1,1} - I_{Lm}) \cos[\omega_0(t-t_3)] - \frac{V_{in}}{2Z_0} \sin[\omega_0(t-t_3)] \end{cases} \quad (8)$$

Since $v_{ds,Q3}+v_{ds,Q4}=V_{mid}=V_{in}/2$, two trajectories during Mode 4 can be derived:

TABLE I. PRIMARY-SIDE SWITCHES VOLTAGE AND CURRENT STRESS COMPARISON

Topology	Voltage Stress	Current Stress
Conventional LLC	V_{in}	I_{Lr}
Proposed DCX	$V_{in}/2$	$I_{Lr}/2$

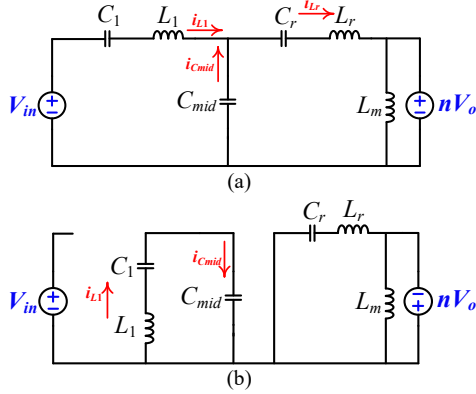


Fig. 5. Simplified equivalent circuits: (a) Mode1&2. (b) Mode 5&6.

$$\begin{cases} \left[\frac{V_{in}}{2} - v_{ds,Q3}(t) \right]^2 + [i_{L1}(t) - I_{Lm}]^2 Z_0^2 = [(I_{L1-1} - I_{Lm})Z_0]^2 + \left(\frac{V_{in}}{2}\right)^2 \\ [v_{ds,Q4}(t)]^2 + [i_{L1}(t) - I_{Lm}]^2 Z_0^2 = [(I_{L1-1} - I_{Lm})Z_0]^2 + \left(\frac{V_{in}}{2}\right)^2 \end{cases} \quad (9)$$

The complete trajectories of $(i_{L1} - I_{Lm})Z_0$ with respect to $v_{ds,Q3}$ and $v_{ds,Q4}$ can be plotted in Fig. 4(c) and (d). The minimum dead time t_{d2} is constrained by the following inequality:

$$t_{d2} \geq \left[\frac{\pi}{2} - \arctan\left(\frac{I_{Lm} - I_{L1-1}}{V_{in}/2}\right) \right] / \omega_0. \quad (10)$$

C. Electrical Rating Analysis

The switch voltage rating is established based on the voltage across the capacitors. In the RSC cell with 2:1 voltage conversion ratio, the DC components of both v_{mid} and v_{RT1} are equal to $V_{in}/2$, thereby yielding an equivalent voltage stress of $V_{in}/2$ on switched $Q_{1,4}$.

The current stress on the switches is determined by the currents i_{L1} , i_{Cmid} and i_{Lr} . To simplify the analysis, the dead time during switching transition is neglected. The further simplified equivalent circuits are shown in Fig. 5. Thus, the relationships between these currents are satisfied as follows:

$$\begin{cases} i_{Cmid} = i_{Lr} - i_{L1}, & \text{in Mode 1,2} \\ i_{Cmid} = i_{L1}, & \text{in Mode 5,6} \end{cases} \quad (11)$$

Since the durations of Mode 1,2 and Mode 5,6 are both 50% of the switching period without dead time, i_{L1} and i_{Cmid} can be approximated as nearly equal to $i_{Lr}/2$. By analyzing the current flow through the switches, it becomes evident that the current stresses of switches $Q_{1,4}$ are all equal to $i_{Lr}/2$.

Table I compares the electrical rating between the proposed converter and conventional LLC converter. It indicates that the voltage and current stresses of the primary-side switches in the proposed converter are both lower than that of conventional LLC converter.

TABLE II. PARAMETERS OF PROTOTYPE

Symbol	Meaning	Value
V_{in}	Input Voltage	48 V
V_o	Output Voltage	12 V
P_o	Rated Power	300 W
f_s	Switching Frequency	1 MHz
n	Transformer Turns Ratio	1
C_1	Resonant Capacitor	0.88 μ F
L_1	Resonant Inductor	50 nH
C_{mid}	Non-resonant Capacitor	100 μ F
C_r	Resonant Capacitor	1.98 μ F
L_r	Resonant (Leakage) Inductor	12 nH
L_m	Magnetizing Inductor	350 nH

III. EXPERIMENTAL VERIFICATION

To verify the operational concept of the proposed topology, a hardware prototype operating at 1 MHz was constructed. The prototype features a 48V input and produces a 12V/25A output. To achieve a compact magnetic profile, a planar transformer was specifically designed for this purpose. Moreover, the leakage inductance of the transformer can be utilized as the resonant inductance L_r , offering the additional advantage of improving the overall power density of the transformer.

The key parameters related to the experimental setup are summarized in Table II, while the corresponding experimental results are depicted in Fig. 6. The waveforms of the drain-to-source voltage v_{ds} , and the gate-to-source voltage v_{gs} of $Q_{2,4}$ at 80% load are captured in Fig. 6(a) and Fig. 6(b), respectively. These waveforms effectively demonstrate that the ZVS operation is successfully achieved for both switches. Based on the symmetrical operations, it can be deduced that ZVS operation is also achieved for $Q_{1,3}$. Furthermore, the waveforms of resonant currents i_{L1} and i_{Lr} are consistent with the theoretical analysis.

Fig. 6(c) presents the waveforms of the middle bus voltage v_{mid} , the output voltage v_o , the voltage v_{Cr} on the resonant capacitor C_r , and the resonant current i_{Lr} . The value of v_{mid} and v_o remain constant at 24V and 12V, respectively, while v_{Cr} exhibits a sinusoidal waveform center around 12V. The efficiency is measured by the N4L PPA4500 power analyzer, and the efficiency curve versus the output power is plotted in Fig. 7. Notably, the prototype achieves a peak efficiency of 94.22% at half-load condition.

IV. CONCLUSION

In this paper, a hybrid DCX based on resonant switched-capacitor and LLC converter is proposed for data center applications. It enables 4n:1 conversion ratio with an n:1 transformer to optimize the transformer design. Meanwhile, all primary-side switches can achieve ZVS, and the ZVS conditions of different switches are analyzed in detail to facilitate the design. Moreover, the primary-side switches have lower voltage and current stresses than that of conventional LLC converter, resulting in enhanced performance.

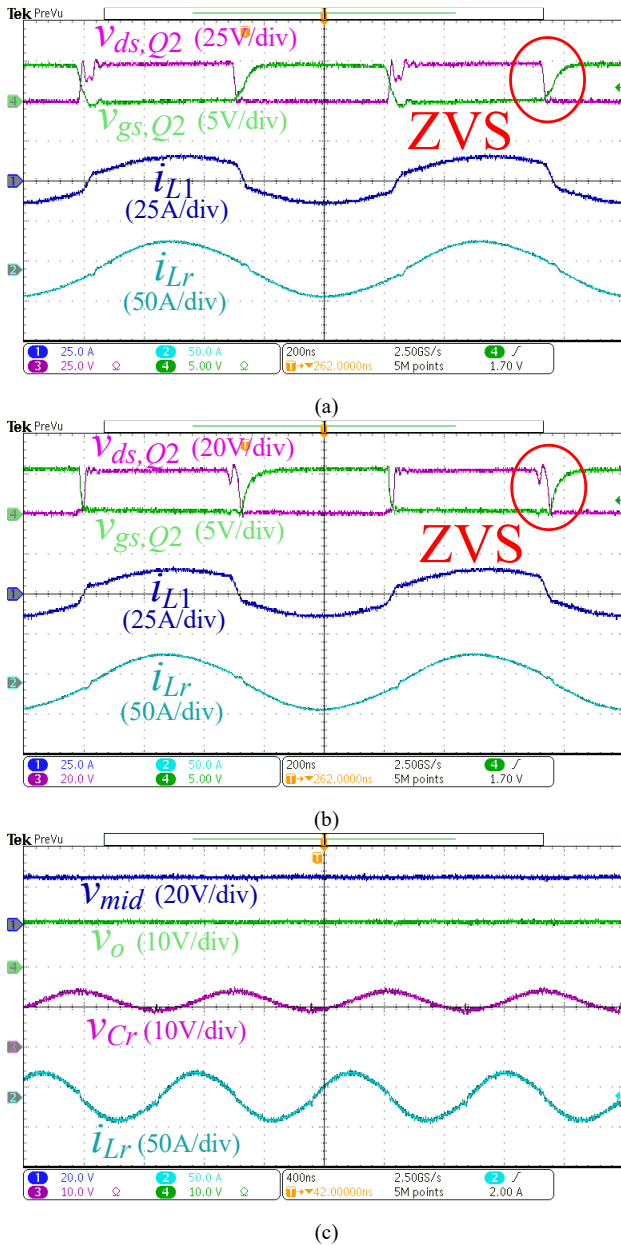


Fig. 6. Experiment results: (a-b) the drain-to-source and gate-to-source voltage waveforms of $Q_{2,4}$, and the resonant current waveforms of L_1 and L_r . (c) the voltage waveforms of C_{mid} , C_o , C_r , and the resonant current waveforms of L_r .

A 48V input to 12V/25A output hardware prototype is designed and tested. The experimental results are presented to validate the analysis and demonstrate the effectiveness of the hybrid DCX design. The peak efficiency is 94.22% at 50% load. In the future, a more compact converter prototype with smaller parasitic parameters will be designed to further improve efficiency and power density.

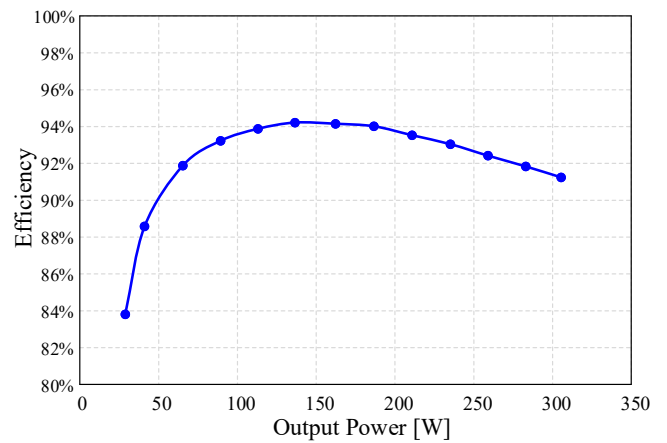


Fig. 7. Measured efficiency versus output power.

REFERENCES

- [1] "Data center & the environment," 2021, [Online]. Available: [https://marketing-email.supermicro.com/hubfs/PDFs/DataCenters&theEnvironmentReport2021CondensedV1%20\(1\).pdf](https://marketing-email.supermicro.com/hubfs/PDFs/DataCenters&theEnvironmentReport2021CondensedV1%20(1).pdf)
- [2] X. Li and S. Jiang, "Google 48V Power Architecture," in *Keynotes presentation IEEE Appl. Power Electron. Conf. Expo. (APEC)*, Tampa, FL, Mar. 2017.
- [3] S. Mills, "Overview of Open Rack Standard V2.0," in *Proc. OCP Eng. Workshop*, Aug. 2016, pp. 1–28. [Online]. Available: <https://hyperscaleit.com/wp-content/uploads/2017/04/OCP-Engineering-Workshop-Open-Rack-V2.0-2016-08-10.pdf>
- [4] M. Salato, "Datacenter power architecture: IBA versus FPA," in *Proc. IEEE Int. Telecommun. Energy Conf. (INTELEC)*, Amsterdam, Netherlands, Oct. 2011, pp. 1–4.
- [5] X. Lyu, Y. Li, N. Ren, C. Nan, D. Cao, and S. Jiang, "Optimization of High-Density and High-Efficiency Switched-Tank Converter for Data Center Applications," *IEEE Trans. Ind. Electron.*, vol. 67, no. 2, pp. 1626–1637, Feb. 2020.
- [6] L. Wang, C. Li, J. Liang, and H. Wang, "A Multi-phase Series Capacitor Trans-inductor Voltage Regulator with High Switching Frequency and Fast Dynamic Response," in *Proc. IEEE Appl. Power Electron. Conf. Expo. (APEC)*, Orlando, FL, Mar. 2023, pp. 2207–2212.
- [7] J. Liang, L. Wang, M. Fu, J. Liang, and H. Wang, "Overview of Voltage Regulator Modules in 48 V Bus-Based Data Center Power Systems," *CPSS Trans. Power Electron. Appl.*, vol. 7, no. 3, pp. 283–299, Sep. 2022.
- [8] S. Li, W. Xie, and K. M. Smedley, "A Family of an Automatic Interleaved Dickson Switched-Capacitor Converter and Its ZVS Resonant Configuration," *IEEE Trans. Ind. Electron.*, vol. 66, no. 1, pp. 255–264, Jan. 2019.
- [9] Y. Li, X. Lyu, D. Cao, S. Jiang, and C. Nan, "A 98.55% Efficiency Switched-Tank Converter for Data Center Application," *IEEE Trans. Ind. Appl.*, vol. 54, no. 6, pp. 6205–6222, Nov.–Dec. 2018.
- [10] S. Jiang, S. Saggini, C. Nan, X. Li, C. Chung, and M. Yazdani, "Switched Tank Converters," *IEEE Trans. Power Electron.*, vol. 34, no. 6, pp. 5048–5062, Apr. 2019.
- [11] J. Liang, H. Wang, and H. Yang, "A Merged H-Bridge Based Switched Tank Converter for Front-End Voltage Regulator Modules," in *Proc. IEEE Energy Convers. Congr. Expo. (ECCE)*, Vancouver, BC, Oct. 2021, pp. 1995–2000.
- [12] M. Fu, C. Fei, Y. Yang, Q. Li, and F. C. Lee, "Optimal Design of Planar Magnetic Components for a Two-Stage GaN-Based DC–DC Converter," *IEEE Trans. Power Electron.*, vol. 34, no. 4, pp. 3329–3338, Apr. 2019.
- [13] Y. Cai, M. H. Ahmed, Q. Li, and F. C. Lee, "Optimal Design of Megahertz LLC Converter for 48-V Bus Converter Application," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 8, no. 1, pp. 495–505, Mar. 2020.
- [14] T. Liu, X. Wu, and S. Yang, "1 MHz 48–12 V Regulated DCX With Single Transformer," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 9, no. 1, pp. 38–47, Feb. 2021.